

State Water Resources Control Board
Division of Drinking Water

April 18, 2016
System No.: 1500555

Ms. Gina Hayden, Secretary
Mustang Mutual Water System
P. O. Box 11131
Bakersfield, CA 93389

RE: Citation No. 03_12_16C_006
Total Coliform Maximum Contaminant Level Violation
For February 2016

Dear Ms. Hayden:

Enclosed is a Citation issued to the Mustang Mutual Water System (hereinafter "Water System") public water system for noncompliance with the total coliform maximum contaminant level (MCL).

The Water System will be billed at the State Water Resources Control Board's (hereinafter "State Board") hourly rate (currently estimated at \$153.00) for the time spent on issuance of this citation. The California Health and Safety Code Section 116577 provides that a public water system must reimburse the State Board for actual costs incurred by the State Board for specified enforcement actions, including but not limited to, preparing, issuing and monitoring compliance with a citation.

The Water System will receive a bill sent from the State Board in August of the next fiscal year. This bill will contain fees for any enforcement time spent on Water System for the current fiscal year.

If you have any questions regarding this matter, please contact Mrs. Cristina Knudsen of my staff or me at (559) 447-3300.

Sincerely,



Tricia A. Wathen, P.E.
Senior Sanitary Engineer, Visalia District
SOUTHERN CALIFORNIA BRANCH
DRINKING WATER FIELD OPERATIONS

TAW/LR

Enclosures

Certified Mail No. 7015 1660 0000 0781 8145

cc: Kern County Environmental Health Department
Seaco Technologies, 3220 Patton Way, Bakersfield, CA 93308

STATE OF CALIFORNIA
STATE WATER RESOURCES CONTROL BOARD
DIVISION OF DRINKING WATER

Name of Public Water System: Mustang Mutual Water System

Water System No: 1500555

Attention: Ms. Gina Hayden, Secretary
P. O. Box 11131
Bakersfield, CA 93389

Issued: April 18, 2016

CITATION FOR NONCOMPLIANCE
TOTAL COLIFORM MAXIMUM CONTAMINANT LEVEL VIOLATION
CALIFORNIA CODE OF REGULATIONS, TITLE 22, SECTION 64426.1
FEBRUARY 2016

The California Health and Safety Code (hereinafter "CHSC"), Section 116650 authorizes the State Water Resources Control Board (hereinafter "State Board") to issue a citation to a public water system when the State Board determines that the public water system has violated or is violating the California Safe Drinking Water Act (hereinafter "California SDWA"), (CHSC, Division 104, Part 12, Chapter 4, commencing with Section 116270), or any regulation, standard, permit, or order issued or adopted thereunder.

1 The State Board, acting by and through its Division of Drinking Water (hereinafter
2 "Division") and the Deputy Director for the Division, hereby issues this citation pursuant
3 to Section 116650 of the CHSC to the Mustang Mutual Water System (hereinafter
4 "Water System") for violation of CHSC, Section 116555(a)(1) and, California Code of
5 Regulations (hereinafter "CCR"), Title 22, Section 64426.1.

6
7 A copy of the applicable statutes and regulations are included in Appendix 1, which is
8 attached hereto and incorporated by reference.

9 10 **STATEMENT OF FACTS**

11 The Water System is classified as a community water system with a population of 20
12 persons served through 50 service connections. The Division received laboratory
13 results for 14 bacteriological samples collected during February 2016 from the Water
14 System. One (1) routine sample tested positive for total coliform bacteria and positive
15 for *Escherichia coli* (*E. coli*) bacteria. One (1) of the repeat samples tested positive for
16 total coliform bacteria.

17 18 **DETERMINATION**

19 CCR, Title 22, Section 64426.1, Total Coliform Maximum Contaminant Level (MCL)
20 states that a public water system is in violation of the total coliform MCL if any repeat
21 sample following a fecal coliform-positive or *E. coli*-positive routine sample is total
22 coliform-positive.

23
24 The Water System was required to take 13 repeat bacteriological samples during
25 February 2016 following one (1) *E. coli* positive routine sample. The results of the
26 analysis of one (1) repeat sample was positive for total coliform bacteria. Therefore, the
27

1 Division has determined that the Water System violated CCR, Title 22, Section
2 64426.1 during February 2016.

3
4 **DIRECTIVES**

5 The Water System is hereby directed to take the following actions:

- 6
- 7 1. Comply with CCR, Title 22, Section 64426.1, in all future monitoring periods.
8
 - 9 2. On or before April 30, 2016 notify all persons served by the Water System of the
10 violation of Section 64426.1, in conformance with CCR, Title 22, Sections
11 64463.4(b)&(c) and 64465. Copies of Sections 64463.4 and 64465 are included in
12 Appendix 1. Appendix 2: Notification Template shall be used to fulfill this directive
13 unless otherwise approved by the Division.
14
 - 15 3. Complete Appendix 3: Compliance Certification Form. Submit it together with a
16 copy of the public notification required by Directive 2 to the Division on or before
17 **May 10 ,2016.**
18
 - 19 4. Submit the information required by CCR, Title 22, Section 64426(b)(2) on or before
20 May 10, 2016. Appendix 4: Positive Total Coliform Investigation may be used to
21 fulfill this directive.
22

23 All submittals required by this Citation shall be submitted to the Division at the following
24 address:
25
26
27

Tricia Wathen, P.E., Senior Sanitary Engineer
State Water Resources Control Board
Division of Drinking Water, Visalia District
265 W. Bullard Ave, Suite 101
Fresno, CA 93704

The State Board reserves the right to make such modifications to this Citation as it may deem necessary to protect public health and safety. Such modifications may be issued as amendments to this Citation and shall be effective upon issuance.

Nothing in this Citation relieves the Water System of its obligation to meet the requirements of the California SDWA (CHSC, Division 104, Part 12, Chapter 4, commencing with Section 116270), or any regulation, standard, permit or order issued or adopted thereunder.

PARTIES BOUND

This Citation shall apply to and be binding upon the Water System, its owners, shareholders, officers, directors, agents, employees, contractors, successors, and assignees.

SEVERABILITY

The directives of this Citation are severable, and the Water System shall comply with each and every provision thereof notwithstanding the effectiveness of any provision.

FURTHER ENFORCEMENT ACTION

The California SDWA authorizes the State Board to: issue a citation with assessment of administrative penalties to a public water system for violation or continued violation

1 of the requirements of the California SDWA or any regulation, permit, standard,
2 citation, or order issued or adopted thereunder including, but not limited to, failure to
3 correct a violation identified in a citation or compliance order. The California SDWA
4 also authorizes the State Board to take action to suspend or revoke a permit that has
5 been issued to a public water system if the public water system has violated applicable
6 law or regulations or has failed to comply with an order of the State Board, and to
7 petition the superior court to take various enforcement measures against a public water
8 system that has failed to comply with an order of the State Board. The State Board
9 does not waive any further enforcement action by issuance of this Citation.

10
11 Tricia Wathen

12 Tricia Wathen, P.E.
13 Senior Sanitary Engineer, Visalia District
14 DRINKING WATER FIELD OPERATIONS BRANCH

April 18, 2016
Date

15 Appendices (7):

- 16 1. Applicable Statutes and Regulations
- 17 2. Boil Water Order Notice Issued & Cancellation for February 2016
- 18 3. Tier 2 Notification Template for February 2016
- 19 4. Proof of Notification Form for February 2016
- 20 5. Positive Total Coliform Investigation report
- 21 6. Summary of Distribution Bacteriological Samples
- 22 7. Summary of Source Bacteriological Samples

23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139
140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179
180
181
182
183
184
185
186
187
188
189
190
191
192
193
194
195
196
197
198
199
200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360
361
362
363
364
365
366
367
368
369
370
371
372
373
374
375
376
377
378
379
380
381
382
383
384
385
386
387
388
389
390
391
392
393
394
395
396
397
398
399
400
401
402
403
404
405
406
407
408
409
410
411
412
413
414
415
416
417
418
419
420
421
422
423
424
425
426
427
428
429
430
431
432
433
434
435
436
437
438
439
440
441
442
443
444
445
446
447
448
449
450
451
452
453
454
455
456
457
458
459
460
461
462
463
464
465
466
467
468
469
470
471
472
473
474
475
476
477
478
479
480
481
482
483
484
485
486
487
488
489
490
491
492
493
494
495
496
497
498
499
500
501
502
503
504
505
506
507
508
509
510
511
512
513
514
515
516
517
518
519
520
521
522
523
524
525
526
527
528
529
530
531
532
533
534
535
536
537
538
539
540
541
542
543
544
545
546
547
548
549
550
551
552
553
554
555
556
557
558
559
560
561
562
563
564
565
566
567
568
569
570
571
572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603
604
605
606
607
608
609
610
611
612
613
614
615
616
617
618
619
620
621
622
623
624
625
626
627
628
629
630
631
632
633
634
635
636
637
638
639
640
641
642
643
644
645
646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704
705
706
707
708
709
710
711
712
713
714
715
716
717
718
719
720
721
722
723
724
725
726
727
728
729
730
731
732
733
734
735
736
737
738
739
740
741
742
743
744
745
746
747
748
749
750
751
752
753
754
755
756
757
758
759
760
761
762
763
764
765
766
767
768
769
770
771
772
773
774
775
776
777
778
779
780
781
782
783
784
785
786
787
788
789
790
791
792
793
794
795
796
797
798
799
800
801
802
803
804
805
806
807
808
809
810
811
812
813
814
815
816
817
818
819
820
821
822
823
824
825
826
827
828
829
830
831
832
833
834
835
836
837
838
839
840
841
842
843
844
845
846
847
848
849
850
851
852
853
854
855
856
857
858
859
860
861
862
863
864
865
866
867
868
869
870
871
872
873
874
875
876
877
878
879
880
881
882
883
884
885
886
887
888
889
890
891
892
893
894
895
896
897
898
899
900
901
902
903
904
905
906
907
908
909
910
911
912
913
914
915
916
917
918
919
920
921
922
923
924
925
926
927
928
929
930
931
932
933
934
935
936
937
938
939
940
941
942
943
944
945
946
947
948
949
950
951
952
953
954
955
956
957
958
959
960
961
962
963
964
965
966
967
968
969
970
971
972
973
974
975
976
977
978
979
980
981
982
983
984
985
986
987
988
989
990
991
992
993
994
995
996
997
998
999
1000

Certified Mail No. 7015 1660 0000 0781 8145



APPENDIX 1. APPLICABLE STATUTES AND REGULATIONS FOR

Violations of Total Coliform Rule

California Health and Safety Code (CHSC):

Section 116271 states in relevant part:

(a) The State Water Resources Control Board succeeds to and is vested with all of the authority, duties, powers, purposes, functions, responsibilities, and jurisdiction of the State Department of Public Health, its predecessors, and its director for purposes of all of the following:

- (1) The Environmental Laboratory Accreditation Act (Article 3 (commencing with Section 100825) of Chapter 4 of Part 1 of Division 101).
- (2) Article 3 (commencing with Section 106875) of Chapter 4 of Part 1.
- (3) Article 1 (commencing with Section 115825) of Chapter 5 of Part 10.
- (4) This chapter and the Safe Drinking Water State Revolving Fund Law of 1997 (Chapter 4.5 (commencing with Section 116760)).
- (5) Article 2 (commencing with Section 116800), Article 3 (commencing with Section 116825), and Article 4 (commencing with Section 116875) of Chapter 5.
- (6) Chapter 7 (commencing with Section 116975).
- (7) The Safe Drinking Water, Water Quality and Supply, Flood Control, River and Coastal Protection Bond Act of 2006 (Division 43 (commencing with Section 75001) of the Public Resources Code).
- (8) The Water Recycling Law (Chapter 7 (commencing with Section 13500) of Division 7 of the Water Code).
- (9) Chapter 7.3 (commencing with Section 13560) of Division 7 of the Water Code.
- (10) The California Safe Drinking Water Bond Law of 1976 (Chapter 10.5 (commencing with Section 13850) of Division 7 of the Water Code).
- (11) Wholesale Regional Water System Security and Reliability Act (Division 20.5 (commencing with Section 73500) of the Water Code).
- (12) Water Security, Clean Drinking Water, Coastal and Beach Protection Act of 2002 (Division 26.5 (commencing with Section 79500) of the Water Code).

(b) The State Water Resources Control Board shall maintain a drinking water program and carry out the duties, responsibilities, and functions described in this section. Statutory reference to "department," "state department," or "director" regarding a function transferred to the State Water Resources Control Board shall refer to the State Water Resources Control Board. This section does not impair the authority of a local health officer to enforce this chapter or a county's election not to enforce this chapter, as provided in Section 116500...

- (k)
- (1) The State Water Resources Control Board shall appoint a deputy director who reports to the executive director to oversee the issuance and enforcement of public water system permits and other duties as appropriate. The deputy director shall have public health expertise.
 - (2) The deputy director is delegated the State Water Resources Control Board's authority to provide notice, approve notice content, approve emergency notification plans, and take other action pursuant to Article 5 (commencing with Section 116450), to issue, renew, reissue, revise, amend, or deny any public water system permits pursuant to Article 7 (commencing with Section 116525), to suspend or revoke any public water system permit pursuant to Article 8 (commencing with Section 116625), and to issue citations, assess penalties, or issue orders pursuant to Article 9 (commencing with Section 116650). Decisions and actions of the deputy director taken pursuant to Article 5 (commencing with Section 116450) or Article 7 (commencing with Section 116525) are deemed decisions and actions taken, but are not subject to reconsideration, by the State Water Resources Control Board. Decisions and actions of the deputy director taken pursuant to Article 8 (commencing with Section 116625) and Article 9 (commencing with Section 116650) are deemed decisions and actions taken by the State Water Resources Control Board, but any aggrieved person may petition the State Water Resources Control Board for reconsideration of the decision or action. This subdivision is not a limitation on the State Water Resources Control Board's authority to delegate any other powers and duties.

Section 116555 states in relevant part:

(a) Any person who owns a public water system shall ensure that the system does all of the following:

- (1) Complies with primary and secondary drinking water standards.
- (2) Will not be subject to backflow under normal operating conditions.
- (3) Provides a reliable and adequate supply of pure, wholesome, healthful, and potable water.

Section 116650 states in relevant part:

(a) If the department determines that a public water system is in violation of this chapter or any regulation, permit, standard, citation, or order issued or adopted thereunder, the department may issue a citation to the public water system. The citation shall be served upon the public water system personally or by certified mail. Service shall be deemed effective as of the date of personal service or the date of receipt of the certified mail. If a person to whom a citation is directed refuses to accept delivery of the certified mail, the date of service shall be deemed to be the date of mailing.

(b) Each citation shall be in writing and shall describe the nature of the violation or violations, including a reference to the statutory provision, standard, order, citation, permit, or regulation alleged to have been violated.

(c) A citation may specify a date for elimination or correction of the condition constituting the violation.

- (d) A citation may include the assessment of a penalty as specified in subdivision (e).
- (e) The department may assess a penalty in an amount not to exceed one thousand dollars (\$1,000) per day for each day that a violation occurred, and for each day that a violation continues to occur. A separate penalty may be assessed for each violation.

California Code of Regulations, Title 22 (CCR):

Section 64421 (General Requirements) states:

- (a) Each water supplier shall:
 - (1) Develop a routine sample siting plan as required in section 64422;
 - (2) Collect routine, repeat and replacement samples as required in Sections 64423, 64424, and 64425;
 - (3) Have all samples analyzed by laboratories approved to perform those analyses by the State Board and report results as required in section 64423.1;
 - (4) Notify the State Board when there is an increase in coliform bacteria in bacteriological samples as required in section 64426; and
 - (5) Comply with the Maximum Contaminant Level as required in section 64426.1.
- (b) Water suppliers shall perform additional bacteriological monitoring as follows:
 - (1) After construction or repair of wells;
 - (2) After main installation or repair;
 - (3) After construction, repair, or maintenance of storage facilities; and
 - (4) After any system pressure loss to less than five psi. Samples collected shall represent the water quality in the affected portions of the system.

Section 64422 (Routine Sample Siting Plan) states:

- (a) By September 1, 1992, each water supplier shall develop and submit to the State Board a siting plan for the routine collection of samples for total coliform analysis, subject to the following:
 - (1) The sample sites chosen shall be representative of water throughout the distribution system including all pressure zones, and areas supplied by each water source and distribution reservoir.
 - (2) The water supplier may rotate sampling among the sample sites if the total number of sites needed to comply with (a)(1) above exceeds the number of samples required according to Table 64423-A. The rotation plan shall be described in the sample siting plan.
- (b) If personnel other than certified operators will be performing field tests and/or collecting samples, the sample siting plan shall include a declaration that such personnel have been trained, pursuant to §64415 (b).
- (c) The supplier shall submit an updated plan to the State Board at least once every ten years and at any time the plan no longer ensures representative monitoring of the system.

Section 64423 (Routine Sampling) states:

- (a) Each water supplier shall collect routine bacteriological water samples as follows:
 - (1) The minimum number of samples for community water systems shall be based on the known population served or the total number of service connections, whichever results in the greater number of samples, as shown in Table 64423-A. A community water system using groundwater which serves 25-1000 persons may request from the State Board a reduction in monitoring frequency. The minimum reduced frequency shall not be less than one sample per quarter.
 - (2) The minimum number of samples for nontransient-noncommunity water systems shall be based on the known population served as shown in Table 64423-A during those months when the system is operating. A nontransient-noncommunity water system using groundwater which serves 25-1000 persons may request from the State Board a reduction in monitoring frequency if it has not violated the requirements in this article during the past twelve months. The minimum reduced frequency shall not be less than one sample per quarter.
 - (3) The minimum number of samples for transient-noncommunity water systems using groundwater and serving 1000 or fewer persons a month shall be one in each calendar quarter during which the system provides water to the public.
 - (4) The minimum number of samples for transient-noncommunity water systems using groundwater and serving more than 1000 persons during any month shall be based on the known population served as shown in Table 64423-A, except that the water supplier may request from the State Board a reduction in monitoring for any month the system serves 1000 persons or fewer. The minimum reduced frequency shall not be less than one sample in each calendar quarter during which the system provides water to the public.
 - (5) The minimum number of samples for transient-noncommunity water systems using approved surface water shall be based on the population served as shown in Table 64423-A. A system using groundwater under the direct influence of surface water shall begin monitoring at this frequency by the end of the sixth month after the State Board has designated the source to be approved surface water.
 - (6) A public water system shall collect samples at regular time intervals throughout the month, except that a system using groundwater which serves 4,900 persons or fewer may collect all required samples on a single day if they are taken from different sites.
- (b) In addition to the minimum sampling requirements, all water suppliers using approved surface water which do not practice treatment in compliance with Sections 64650 through 64666, shall collect a minimum of one sample before or at the first service connection each day during which the turbidity level of the water delivered to the system exceeds 1 NTU. The sample shall be collected within 24 hours of the exceedance and shall be analyzed for total

coliforms. If the water supplier is unable to collect and/or analyze the sample within the 24-hour time period because of extenuating circumstances beyond its control, the supplier shall notify the State Board within the 24-hour time period and may request an extension. Sample results shall be included in determining compliance with the MCL for total coliforms in Section 64426.1.

(c) If any routine, repeat, or replacement sample is total coliform-positive, then the water supplier shall collect repeat samples in accordance with Section 64424 and comply with the reporting requirements specified in Sections 64426 and 64426.1.

Table 64423-A
Minimum Number of Routine Total Coliform Samples

Monthly Population Served	Service Connections	Minimum Number of Samples
25 to 1000	15 to 400	1 per month
1,001 to 2,500	401 to 890	2 per month
2,501 to 3,300	891 to 1,180	3 per month
3,301 to 4,100	1,181 to 1,460	4 per month
4,101 to 4,900	1,461 to 1,750	5 per month
4,901 to 5,800	1,751 to 2,100	6 per month
5,801 to 6,700	2,101 to 2,400	7 per month
6,701 to 7,600	2,401 to 2,700	2 per week
7,601 to 12,900	2,701 to 4,600	3 per week
12,901 to 17,200	4,601 to 6,100	4 per week
17,201 to 21,500	6,101 to 7,700	5 per week
21,501 to 25,000	7,701 to 8,900	6 per week
25,001 to 33,000	8,901 to 11,800	8 per week
33,001 to 41,000	11,801 to 14,600	10 per week
41,001 to 50,000	14,601 to 17,900	12 per week
50,001 to 59,000	17,901 to 21,100	15 per week
59,001 to 70,000	21,101 to 25,000	18 per week
70,001 to 83,000	25,001 to 29,600	20 per week
83,001 to 96,000	29,601 to 34,300	23 per week
96,001 to 130,000	34,301 to 46,400	25 per week
130,001 to 220,000	46,401 to 78,600	30 per week
220,001 to 320,000	78,601 to 114,300	38 per week
320,001 to 450,000	114,301 to 160,700	50 per week
450,001 to 600,000	160,701 to 214,300	55 per week
600,001 to 780,000	214,301 to 278,600	60 per week
780,001 to 970,000	278,601 to 346,400	70 per week
970,001 to 1,230,000	346,401 to 439,300	75 per week
1,230,001 to 1,520,000	439,301 to 542,900	85 per week
1,520,001 to 1,850,000	542,901 to 660,700	90 per week
1,850,001 to 2,270,000	660,701 to 810,700	98 per week
2,270,001 to 3,020,000	810,701 to 1,078,600	105 per week
3,020,001 to 3,960,000	1,078,601 to 1,414,300	110 per week
3,960,001 or more	1,414,301 or more	120 per week

Section 64423.1 (Sample Analysis and Reporting of Results) states:

(a) The water supplier shall designate (label) each sample as routine, repeat, replacement, or "other" pursuant to Section 64421(b), and have each sample analyzed for total coliforms. The supplier also shall require the laboratory to analyze the same sample for fecal coliforms or *Escherichia coli* (E. coli) whenever the presence of total coliforms is indicated. As a minimum, the analytical results shall be reported in terms of the presence or absence of total or fecal coliforms, or E. coli in the sample, whichever is appropriate.

(b) The water supplier shall require the laboratory to notify the supplier within 24 hours, whenever the presence of total coliforms, fecal coliforms or E. coli is demonstrated in a sample or a sample is invalidated due to interference problems, pursuant to Section 64425(b), and shall ensure that a contact person is available to receive these analytical results 24-hours a day. The water supplier shall also require the laboratory to immediately notify the State Board of any positive bacteriological results if the laboratory cannot make direct contact with the designated contact person within 24 hours.

(c) Analytical results of all required samples collected for a system in a calendar month shall be reported to the State Board not later than the tenth day of the following month, as follows:

(1) The water supplier shall submit a monthly summary of the bacteriological monitoring results to the State Board.

(2) For systems serving fewer than 10,000 service connections or 33,000 persons, the water supplier shall require the laboratory to submit copies of all required bacteriological monitoring results directly to the State Board.

- (3) For systems serving more than 10,000 service connections, or 33,000 persons, the water supplier shall require the laboratory to submit copies of bacteriological monitoring results for all positive routine samples and all repeat samples directly to the State Board.
- (d) Laboratory reports shall be retained by the water supplier for a period of at least five years and shall be made available to the State Board upon request.

Section 64424 (Repeat Sampling) states in relevant part:

(a) If a routine sample is total coliform-positive, the water supplier shall collect a repeat sample set as described in paragraph (1) within 24 hours of being notified of the positive result. The repeat samples shall all be collected within the same 24 hour time period. A single service connection system may request that the State Board allow the collection of the repeat sample set over a four-day period.

(1) For a water supplier that normally collects more than one routine sample a month, a repeat sample set shall be at least three samples for each total coliform-positive sample. For a water supplier that normally collects one or fewer samples per month, a repeat sample set shall be at least four samples for each total coliform-positive sample.

(2) If the water supplier is unable to collect the samples within the 24-hour time period specified in subsection (a) or deliver the samples to the laboratory within 24 hours after collection because of circumstances beyond its control, the water supplier shall notify the State Board within 24 hours. The State Board will then determine how much time the supplier will have to collect the repeat samples.

(b) When collecting the repeat sample set, the water supplier shall collect at least one repeat sample from the sampling tap where the original total coliform-positive sample was taken. Other repeat samples shall be collected within five service connections upstream or downstream of the original site. At least one sample shall be from upstream and one from downstream unless there is no upstream and/or downstream service connection.

(c) If one or more samples in the repeat sample set is total coliform-positive, the water supplier shall collect and have analyzed an additional set of repeat samples as specified in subsections (a) and (b). The supplier shall repeat this process until either no coliforms are detected in one complete repeat sample set or the supplier determines that the MCL for total coliforms specified in Section 64426.1 has been exceeded and notifies the State Board.

(d) If a public water system for which fewer than five routine samples/month are collected has one or more total coliform-positive samples, the water supplier shall collect at least five routine samples the following month. If the supplier stops supplying water during the month after the total coliform-positive(s), at least five samples shall be collected during the first month the system resumes operation. A water supplier may request the State Board waive the requirement to collect at least five routine samples the following month, but a waiver will not be granted solely on the basis that all repeat samples are total coliform-negative. To request a waiver, one of the following conditions shall be met:

(1) The State Board conducts a site visit before the end of the next month the system provides water to the public to determine whether additional monitoring and/or corrective action is necessary to protect public health.

(2) The State Board determines why the sample was total coliform-positive and establishes that the system has corrected the problem or will correct the problem before the end of the next month the system serves water to the public. If a waiver is granted, a system shall collect at least one routine sample before the end of the next month it serves water to the public and use it to determine compliance with Section 64426.1.

Section 64425 (Sample Invalidation) states:

(a) A water supplier may request the Department to invalidate a sample for which a total coliform-positive result has been reported if the supplier demonstrates:

(1) All repeat sample(s) collected at the same tap as the original total coliform-positive sample also are total coliform-positive and all repeat samples collected within five service connections of the original tap are not total coliform-positive; or

(2) The laboratory did not follow the prescribed analytical methods pursuant to §64415(a), based on a review of laboratory documentation by the Department. The supplier shall submit to the Department a written request for invalidation along with the laboratory documentation, the supplier's sample collection records and any observations noted during sample collection and delivery. The water supplier shall require the laboratory to provide the supplier with documentation which shall include, but not be limited to:

(A) A letter from the director of the laboratory having generated the data, confirming the invalidation request by reason of laboratory accident or error;

(B) Complete sample identification, laboratory sample log number (if used), date and time of collection, date and time of receipt by the laboratory, date and time of analysis for the sample(s) in question;

(C) Complete description of the accident or error alleged to have invalidated the result(s);

(D) Copies of all analytical, operating, and quality assurance records pertaining to the incident in question; and

(E) Any observations noted by laboratory personnel when receiving and analyzing the sample(s) in question.

(b) Whenever any total coliform sample result indicative of the absence of total coliforms has been declared invalid by the laboratory due to interference problems as specified at 40 Code Federal Regulations, Section 141.2100(c)(2), the supplier shall collect a replacement sample from the same location as the original sample within 24 hours of being notified of the interference problem, and have it analyzed for the presence of total coliforms. The supplier shall

continue to re-sample at the original site within 24 hours and have the samples analyzed until a valid result is obtained.

Section 64426 (Significant Rise in Bacterial Count) states in relevant part:

- (a) Any of the following criteria shall indicate a possible significant rise in bacterial count:
 - (1) A system collecting at least 40 samples per month has a total coliform-positive routine sample followed by two total coliform-positive repeat samples in the repeat sample set;
 - (2) A system has a sample which is positive for fecal coliform or *E. coli*; or
 - (3) A system fails the total coliform Maximum Contaminant Level (MCL) as defined in Section 64426.1.
- (b) When the coliform levels specified in subsection (a) are reached or exceeded, the water supplier shall:
 - (1) Contact the State Board by the end of the day on which the system is notified of the test result or the system determines that it has exceeded the MCL, unless the notification or determination occurs after the State Board office is closed, in which case the supplier shall notify the State Board within 24 hours; and
 - (2) Submit to the State Board information on the current status of physical works and operating procedures which may have caused the elevated bacteriological findings, or any information on community illness suspected of being waterborne. This shall include, but not be limited to:
 - (A) Current operating procedures that are or could potentially be related to the increase in bacterial count;
 - (B) Any interruptions in the treatment process;
 - (C) System pressure loss to less than 5 psi;
 - (D) Vandalism and/or unauthorized access to facilities;
 - (E) Physical evidence indicating bacteriological contamination of facilities;
 - (F) Analytical results of any additional samples collected, including source samples;
 - (G) Community illness suspected of being waterborne; and
 - (H) Records of the investigation and any action taken.

Section 64426.1 (Total Coliform Maximum Contaminant Level (MCL)) states in relevant part:

- (b) A public water system is in violation of the total coliform MCL when any of the following occurs:
 - (1) For a public water system which collects at least 40 samples per month, more than 5.0 percent of the samples collected during any month are total coliform-positive; or
 - (2) For a public water system which collects fewer than 40 samples per month, more than one sample collected during any month is total coliform-positive; or
 - (3) Any repeat sample is fecal coliform-positive or *E. coli*-positive; or
 - (4) Any repeat sample following a fecal coliform-positive or *E. coli*-positive routine sample is total coliform-positive.
- (c) If a public water system is not in compliance with paragraphs (b)(1) through (4), during any month in which it supplies water to the public, the water supplier shall notify the State Board by the end of the business day on which this is determined, unless the determination occurs after the State Board office is closed, in which case the supplier shall notify the State Board within 24 hours of the determination. The water supplier shall also notify the consumers served by the water system. A Tier 2 Public Notice shall be given for violations of paragraph (b)(1) or (2), pursuant to section 64463.4. A Tier 1 Public Notice shall be given for violations of paragraph (b)(3) or (4), pursuant to section 64463.1.

Section 64463.1 (Tier 1 Public Notice) states in relevant part:

- (a) A water system shall give public notice pursuant to this section and section 64465 if any of the following occurs:
 - (1) Violation of the total coliform MCL when:
 - (A) Fecal coliform or *E. coli* are present in the distribution system; or
 - (B) When any repeat sample tests positive for coliform and the water system fails to test for fecal coliforms or *E. coli* in the repeat sample;...
- (b) As soon as possible within 24 hours after learning of any of the violations in subsection (a) or being notified by the State Board that it has determined there is a potential for adverse effects on human health [pursuant to paragraph (a)(4), (5), or (6)], the water system shall:
 - (1) Give public notice pursuant to this section;
 - (2) Initiate consultation with the State Board within the same timeframe; and
 - (3) Comply with any additional public notice requirements that are determined by the consultation to be necessary to protect public health.
- (c) A water system shall deliver the public notice in a manner designed to reach residential, transient, and nontransient users of the water system and shall use, as a minimum, one of the following forms:
 - (1) Radio or television;
 - (2) Posting in conspicuous locations throughout the area served by the water system;
 - (3) Hand delivery to persons served by the water system; or
 - (4) Other method approved by the State Board, based on the method's ability to inform water system users.

Section 64463.4 (Tier 2 Public Notice) states:

- (a) A water system shall give public notice pursuant to this section if any of the following occurs:
 - (1) Any violation of the MCL, MRDL, and treatment technique requirements, except:
 - (A) Where a Tier 1 public notice is required under section 64463.1; or
 - (B) Where the State Board determines that a Tier 1 public notice is required, based on potential health impacts and persistence of the violations;

- (2) All violations of the monitoring and testing procedure requirements in sections 64421 through 64426.1, article 3 (Primary Standards – Bacteriological Quality), for which the State Board determines that a Tier 2 rather than a Tier 3 public notice is required, based on potential health impacts and persistence of the violations;
- (3) Other violations of the monitoring and testing procedure requirements in this chapter, and chapters 15.5, 17 and 17.5, for which the State Board determines that a Tier 2 rather than a Tier 3 public notice is required, based on potential health impacts and persistence of the violations; or
- (4) Failure to comply with the terms and conditions of any variance or exemption in place.
- (b) A water system shall give the notice as soon as possible within 30 days after it learns of a violation or occurrence specified in subsection (a), except that the water system may request an extension of up to 60 days for providing the notice. This extension would be subject to the State Board's written approval based on the violation or occurrence having been resolved and the State Board's determination that public health and welfare would in no way be adversely affected. In addition, the water system shall:
- (1) Maintain posted notices in place for as long as the violation or occurrence continues, but in no case less than seven days;
 - (2) Repeat the notice every three months as long as the violation or occurrence continues. Subject to the State Board's written approval based on its determination that public health would in no way be adversely affected, the water system may be allowed to notice less frequently but in no case less than once per year. No allowance for reduced frequency of notice shall be given in the case of a total coliform MCL violation or violation of a Chapter 17 treatment technique requirement; and
 - (3) For turbidity violations pursuant to sections 64652.5(c)(2) and 64653(c), (d) and (f), as applicable, a water system shall consult with the State Board as soon as possible within 24 hours after the water system learns of the violation to determine whether a Tier 1 public notice is required. If consultation does not take place within 24 hours, the water system shall give Tier 1 public notice within 48 hours after learning of the violation.
- (c) A water system shall deliver the notice, in a manner designed to reach persons served, within the required time period as follows:
- (1) Unless otherwise directed by the State Board in writing based on its assessment of the violation or occurrence and the potential for adverse effects on public health and welfare, community water systems shall give public notice by:
 - (A) Mail or direct delivery to each customer receiving a bill including those that provide their drinking water to others (e.g., schools or school systems, apartment building owners, or large private employers), and other service connections to which water is delivered by the water system; and
 - (B) Use of one or more of the following methods to reach persons not likely to be reached by a mailing or direct delivery (renters, university students, nursing home patients, prison inmates, etc.):
 1. Publication in a local newspaper;
 2. Posting in conspicuous public places served by the water system, or on the Internet; or
 3. Delivery to community organizations.
 - (2) Unless otherwise directed by the State Board in writing based on its assessment of the violation or occurrence and the potential for adverse effects on public health and welfare, noncommunity water systems shall give the public notice by:
 - (A) Posting in conspicuous locations throughout the area served by the water system; and
 - (B) Using one or more of the following methods to reach persons not likely to be reached by a public posting:
 1. Publication in a local newspaper or newsletter distributed to customers;
 2. E-mail message to employees or students;
 3. Posting on the Internet or intranet; or
 4. Direct delivery to each customer.

Section 64465 (Public Notice Content and Format) states in relevant part:

- (a) Each public notice given pursuant to this article, except Tier 3 public notices for variances and exemptions pursuant to subsection (b), shall contain the following:
- (1) A description of the violation or occurrence, including the contaminant(s) of concern, and (as applicable) the contaminant level(s);
 - (2) The date(s) of the violation or occurrence;
 - (3) Any potential adverse health effects from the violation or occurrence, including the appropriate standard health effects language from appendices 64465-A through G;
 - (4) The population at risk, including subpopulations particularly vulnerable if exposed to the contaminant in drinking water;
 - (5) Whether alternative water supplies should be used;
 - (6) What actions consumers should take, including when they should seek medical help, if known;
 - (7) What the water system is doing to correct the violation or occurrence;
 - (8) When the water system expects to return to compliance or resolve the occurrence;
 - (9) The name, business address, and phone number of the water system owner, operator, or designee of the water system as a source of additional information concerning the public notice;
 - (10) A statement to encourage the public notice recipient to distribute the public notice to other persons served, using the following standard language: —Please share this information with all the other people who drink this water, especially those who may not have received this public notice directly (for example, people

in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail; and

(11) For a water system with a monitoring and testing procedure violation, this language shall be included: "We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not your drinking water meets health standards. During [compliance period dates], we [did not monitor or test] or [did not complete all monitoring or testing] for [contaminant(s)], and therefore, cannot be sure of the quality of your drinking water during that time." ...

(c) A public water system providing notice pursuant to this article shall comply with the following multilingual-related requirements:

(2) For a Tier 2 or Tier 3 public notice:

(A) The notice shall contain information in Spanish regarding the importance of the notice, or contain a telephone number or address where Spanish-speaking residents may contact the public water system to obtain a translated copy of the notice or assistance in Spanish; and

(B) When a non-English speaking group other than Spanish-speaking exceeds 1,000 residents or 10 percent of the residents served by the public water system, the notice shall include:

1. Information in the appropriate language(s) regarding the importance of the notice; or
2. A telephone number or address where such residents may contact the public water system to obtain a translated copy of the notice or assistance in the appropriate language; and

(3) For a public water system subject to the Dymally-Alatorre Bilingual Services Act, Chapter 17.5, Division 7, of the Government Code (commencing with section 7290), meeting the requirements of this Article may not ensure compliance with the Dymally-Alatorre Bilingual Services Act.

(d) Each public notice given pursuant to this article shall:

(1) Be displayed such that it catches people's attention when printed or posted and be formatted in such a way that the message in the public notice can be understood at the eighth-grade level;

(2) Not contain technical language beyond an eighth-grade level or print smaller than 12 point; and

(3) Not contain language that minimizes or contradicts the information being given in the public notice.

Appendix 64465-A. Health Effects Language - Microbiological Contaminants.

Contaminant	Health Effects Language
Total Coliform	Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. Coliforms were found in more samples than allowed and this was a warning of potential problems.
Fecal coliform/E. coli	Fecal coliforms and E. coli are bacteria whose presence indicates that the water may be contaminated with human or animal wastes. Microbes in these wastes can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a special health risk for infants, young children, some of the elderly, and people with severely compromised immune systems.
Turbidity	Turbidity has no health effects. However, high levels of turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses, and parasites that can cause symptoms such as nausea, cramps, diarrhea, and associated headaches.

Section 64469 (Reporting Requirements) states in relevant part:

(d) Within 10 days of giving initial or repeat public notice pursuant to Article 18 of this Chapter, except for notice given under section 64463.7(d), each water system shall submit a certification to the State Board that it has done so, along with a representative copy of each type of public notice given.

Section 64481 (Content of the Consumer Confidence Report) states in relevant part:

(g) For the year covered by the report, the Consumer Confidence Report shall note any violations of paragraphs (1) through (7) and give related information, including any potential adverse health effects, and the steps the system has taken to correct the violation.

(1) Monitoring and reporting of compliance data.

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Este informe contiene información muy importante sobre su agua potable.
Tradúzcalo o hable con alguien que lo entienda bien.

DRINKING WATER WARNING

Mustang Mutual Water System water has been contaminated with *E. coli*

BOIL YOUR WATER BEFORE USING

APR - 4 2016

E. coli bacteria was found in the water supply on February 4, 2016. These bacteria can make you sick, and are a particular concern for people with weakened immune systems.

What should I do?

- **DO NOT DRINK THE WATER WITHOUT BOILING IT FIRST.** Bring all water to a boil, let it boil for one minute, and let it cool before using, or use bottled water. Boiled or bottled water should be used for drinking, making ice, brushing teeth, washing dishes, and food preparation **until further notice**. Boiling kills bacteria and other organisms in the water.
- *Fecal coliforms and E. coli are bacteria whose presence indicates that the water may be contaminated with human or animal wastes. Microbes in these wastes can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a special health risk for infants, young children, some of the elderly, and people with severely compromised immune systems. The symptoms above are not caused only by organisms in drinking water. If you experience any of these symptoms and they persist, you may want to seek medical advice.*
- People with severely compromised immune systems, infants, and some elderly may be at increased risk. These people should seek advice about drinking water from their health care providers. General guidelines on ways to lessen the risk of infection by microbes are available from EPA's Safe Drinking Water Hotline at 1(800) 426-4791.

What happened? What is being done?

Bacterial contamination can occur when increased run-off enters the drinking water source (for example, following heavy rains). It can also happen due to a break in the distribution system (pipes) or a failure in the water treatment process. The well has been disinfected. However, state officials want residents to continue using boiled water until the pressure tank is replaced. We will inform you when you no longer need to boil your water.

For more information, please contact Gina Hayden at (661) 301-8430.

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail.

Secondary Notification Requirements

Upon receipt of notification from a person operating a public water system, the following notification must be given within 10 days [Health and Safety Code Section 116450(g)]:

- **SCHOOLS:** Must notify school employees, students, and parents (if the students are minors).
- **RESIDENTIAL RENTAL PROPERTY OWNERS OR MANAGERS** (including nursing homes and care facilities): Must notify tenants.
- **BUSINESS PROPERTY OWNERS, MANAGERS, OR OPERATORS:** Must notify employees of businesses located on the property.

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Este informe contiene información muy importante sobre su agua potable.

Por favor hable con alguien que lo pueda traducir.

CANCELLATION OF BOIL WATER ORDER

Customers of the Mustang Mutual Water Company were notified on February 3, 2016 of a problem with our drinking water and were advised to boil all tap water used for drinking and cooking purposes, or use bottled water. The reason for the boil water order was due to a routine water sample, which showed *E.coli* was present in the water. The water has been disinfected, and the community fire hydrants were flushed. Two samples were recently collected, and water quality results showed the water samples did not contain any bacteria. We are pleased to report that the problem has been corrected, and that it is no longer necessary to boil your water before using it. We apologize for any inconvenience and thank you for your patience.

For more information call:

Mustang Mutual Water Company contact:


Gina Hayden (661) 301-8430

State Water Resources Control Board, Division of Drinking Water
(559) 447-3300

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail.

This notice is being sent to you by: Mustang Mutual Water Company.

Date distributed 2/11/16.

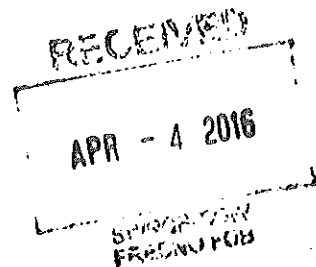

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Este informe contiene información muy importante sobre su agua potable.

Por favor hable con alguien que lo pueda traducir.

Mustang Mutual Water System Had Levels of Coliform Bacteria Above the Drinking Water Standard

Our water system recently failed a drinking water standard. Although this incident was not an emergency, as our customers, you have a right to know what you should do, what happened and what we did to correct this situation.

We routinely monitor for drinking water contaminants. We took 14 samples to test for the presence of coliform bacteria in February 2016. Two (2) of these samples showed the presence of total coliform bacteria and one (1) of the 2 samples also detected the presence of *E. coli* bacteria. The standard is that no more than 1 sample per month may show the presence of coliform bacteria.

What should I do?

- You do not need to boil your water or take other corrective actions.
- This is not an emergency. If it had been, you would have been notified immediately. Total coliform bacteria are generally not harmful themselves. *Coliforms are bacteria which are naturally present in the environment and are used as an indicator that other, potentially-harmful, bacteria may be present. Coliforms were found in more samples than allowed and this was a warning of potential problems.*
- Usually, coliforms are a sign that there could be a problem with the treatment or distribution system (pipes). Whenever we detect coliform bacteria in any sample, we do follow-up testing to see if other bacteria of greater concern, such as fecal coliform or *E. coli*, are present. We did not find any of these bacteria in our subsequent testing and further testing shows that this problem has been resolved.
- People with severely compromised immune systems, infants, and some elderly may be at increased risk. These people should seek advice about drinking water from their health care providers. General guidelines on ways to lessen the risk of infection by microbes are available from EPA's Safe Drinking Water Hotline at 1(800) 426-4791.
- If you have other health issues concerning the consumption of this water, you may wish to consult your doctor.

What happened? What is being done?

[Describe corrective action.] _____ The problem has been resolved and no further action is necessary.

For more information, please contact _____ [insert name of contact] at _____ [insert phone number] or at the following mailing address: _____ [insert business/mailling address].

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail.

Secondary Notification Requirements

Upon receipt of notification from a person operating a public water system, the following notification must be given within 10 days [Health and Safety Code Section 116450(g)]:

- SCHOOLS: Must notify school employees, students, and parents (if the students are minors).
- RESIDENTIAL RENTAL PROPERTY OWNERS OR MANAGERS (including nursing homes and care facilities): Must notify tenants.
- BUSINESS PROPERTY OWNERS, MANAGERS, OR OPERATORS: Must notify employees of businesses located on the property.

This notice is being sent to you by Mustang Mutual Water System.

Date distributed: _____.

PROOF OF NOTIFICATION
(Return with copy of the Notice)

As required by Section 116450 of the California Health and Safety Code, I notified all users of water supplied by the **Mustang Mutual Water System** of the failure to meet the **total coliform bacteria MCL** for the month of **February 2016** as directed by the Division. At least one primary distribution method is required: mail, hand-delivery or newspaper publication. A second method is also required in order to reach persons not likely to be reached by a mailing, direct delivery or newspaper publication (renters, nursing home patients, prison inmates, etc.):

Notification was made on _____
(date)

To summarize report delivery used and good-faith efforts used, please check all items below that apply and fill-in where appropriate:

- ☐ The notice was distributed by mail delivery to each customer served by the water system.
- ☐ The notice was distributed by direct delivery to each customer served by the water system.
Specify direct delivery method(s) used: _____
- ☐ Publication of the notice in a local newspaper or newsletter of general circulation (attach a copy of the published notice, including name of newspaper and date published).
- ☐ Posted the notice at the following conspicuous locations served by the water system (if needed, please attach a list of locations).

- ☐ Posted the notice on the Internet at www._____
- ☐ Other method used to notify customers. _____

DISCLOSURE: Be advised that Section 116725 and 116730 of the California Health and Safety Code state that any person who knowingly makes any false statement on any report or document submitted for the purpose of compliance with the attached order may be liable for a civil penalty not to exceed five thousand dollars (\$5,000) for separate violation for each day that violation continues. In addition, the violators may be prosecuted in criminal court and upon conviction, be punished by a fine of not more than \$25,000 for each day of violation, or be imprisoned in the county jail not to exceed one year, or by both the fine and imprisonment.

Certified by Name and Title: _____

Date: _____ Signature: _____

Due to the Division of Drinking Water within 10 days of notification to the public
Total Coliform MCL Failure / Enforcement Action No.: 03_12_15C_006

POSITIVE TOTAL COLIFORM INVESTIGATION

Simple Well with Pressure Tank Systems

This form is intended to assist public water systems in completing the investigation required by the Division of Drinking Water (Section 64426(b) of Title 22, California Code of Regulations) and may be modified to take into account conditions unique to the system.

ADMINISTRATIVE INFORMATION

PWS Name:		PWSID NUMBER:	
	Name	Address	Telephone #
Operator in Responsible Charge (ORC)			
Person that collected TC samples if different than ORC			
Owner			
Certified Laboratory for Microbiological Analyses			
Date Investigation Completed:			
Month(s) of Total Coliform MCL Failure:			

INVESTIGATION DETAILS

SOURCE	WELL (name)	WELL (name)	WELL (name)	WELL (name)	COMMENTS
1. Inspect each well head for physical defects and report					
a. Is raw water sample tap upstream from point of disinfection?					
b. Is wellhead vent pipe screened?					
c. Is wellhead seal watertight?					
d. Is well head located in pit or is any piping from the wellhead submerged?					
e. Does the ground surface slope towards well head?					
f. Is there evidence of standing water near the wellhead?					
g. Are there any connections to the raw water piping that could be cross connections? (describe all connections in comments)					
h. Is the wellhead secured to prevent unauthorized access?					
i. To what treatment plant (name) does this well pump?					
j. How often do you take a raw water total coliform (TC) test?					
k. Provide the date and result of the last TC test at this location					

DISTRIBUTION SYSTEM

SYSTEM RESPONSES

1. What is the minimum pressure you are maintaining in the distribution system?
2. Did pressure in the distribution system drop to less than 5 psi prior to experiencing the TCR positive finding.

POSITIVE TOTAL COLIFORM INVESTIGATION

Page 2 of 3

DISTRIBUTION SYSTEM	SYSTEM RESPONSES
3. Has the distribution system been worked on within the last week? (service taps, hydrant flushing, main breaks, main extensions, etc.) If yes, provide details.	
4. Are there any signs of excavations near your distribution system not under the direct control of your maintenance staff?	
5. Did you inspect your distribution system to check for mainline leaks? Do you or did you have a mainline leak?	
6. If there was a mainline leak, when was it repaired?	
7. On what date was the distribution system last flushed?	
8. Is there a written flushing procedure you can provide for our review?	
9. Do you have an active cross connection control program?	
10. What is name and phone number of your Cross-Connection Control Program Coordinator?	
11. Is the review and testing of backflow prevention devices current?	
12. On what date was the last physical survey of the system done to identify cross-connections?	

SAMPLE SITE EVALUATION (Complete for all TC+ or EC+ findings)	Routine Site TC+ or EC+	Upstream Site	Downstream Site	Sample 4 (specify)
1. What is the height of the sample tap above grade? (inches)				
2. Is the sample tap located in an exterior location or is it protected by an enclosure?				
3. Is the sample tap threaded, have a swing arm (kitchen sink) or aerator (sinks)?				
4. Is the sample tap in good condition, free of leaks around the stem or packing?				
5. Can the sample tap be adjusted to the point where a good laminar flow can be achieved without excessive splash?				
6. Is the sample tap and area around the sample tap clean and dry (free of animal droppings, other contaminants or spray irrigation systems)				
7. Is the area around the sample tap free of excessive vegetation or other impediments to sample collection				
8. Describe how the tap was treated in preparation for sample collection (ran water, swabbed with disinfectant, flamed, etc.)				
9. Is this sample tap designated on the sampling plan submitted with this information request?				
10. What were the weather conditions at the time of the positive sample (rainy, windy, sunny).				

POSITIVE TOTAL COLIFORM INVESTIGATION

Page 3 of 3

GENERAL OPERATIONS:	Response
1. Where there any power outages that affected water system facilities during the 30 days prior to the TC+ or EC + findings?	
2. Where there any main breaks, water outages, or low pressure reported in the service area where TC+ or EC+ samples were located.	
3. Does the system have backup power or elevated storage?	
4. During or soon after bacteriological quality problems, did you receive any complaints of any customers' illness suspected of being waterborne? How many?	
5. What were the symptoms of illness if you received complaints about customers being sick?	

ADDITIONAL INFORMATION TO BE SUBMITTED WITH RESPONSES TO THE ABOVE QUESTIONS

1. **Sketch** of System showing all sources, treatment locations, storage tanks, microbiological sampling sites and general layout of the distribution system including the location of all hazardous connections such as the wastewater treatment facility.
2. A set of photographs of the well, pressure tanks, and storage tanks in the system may be submitted if they would show that the contamination is directly related and changes have been made since the last inspection by our Department
3. Name, certification level and certificate number of the Operator in Responsible Charge.
4. Copy of the last cross connection survey performed that identifies the location of all unprotected cross connections.

SUMMARY: BASED ON THE RESULTS OF YOUR INVESTIGATION AND ANY OTHER INFORMATION AT YOUR DISPOSAL, WHAT DO YOU BELIEVE TO BE THE CAUSE OF THE POSITIVE TOTAL COLIFORM SAMPLES FROM YOUR PUBLIC WATER SYSTEM?

CERTIFICATION: I CERTIFY THAT THE INFORMATION SUBMITTED IN RESPONSE TO THE QUESTIONS ABOVE IS ACCURATE TO THE BEST OF MY PROFESSIONAL KNOWLEDGE

NAME: _____ TITLE: _____ DATE: _____

Bacteriological Distribution Monitoring Report

1500555 Mustang Mutual WS
Distribution System Freq: 1/M

Sample Date	Location	T Coli	E Coli	F Coli	HPC	Type	Cl2	Cl2 Avg	Viol. Type	GWR Satisfied?	Comments
3/1/2016	5 samples	A	A			Routine					
2/8/2016	2720 Carriage	<1	<1			Repeat					
2/8/2016	2633 Stage Coach	<1	<1			Repeat					
2/8/2016	18000 Buckboard	<1	<1			Repeat					
2/8/2016	18200 Buckboard	<1	<1			Repeat					
2/8/2016	17720 Buckboard	<1	<1			Repeat					
2/5/2016	2720 Carriage	<1	<1			Repeat	0.17				
2/5/2016	2633 Stage Coach	<1	<1			Repeat	0.27				
2/5/2016	18200 Buckboard	<1	<1			Repeat	0.22				
2/5/2016	18000 Buckboard	<1	<1			Repeat	0.24				
2/5/2016	17720 Buckboard	<1	<1			Repeat	0.28				
2/3/2016	18140 Buckboard	<1	<1			Repeat					
2/3/2016	18200 Buckboard	<1	<1			Repeat					
2/3/2016	18220 Buckboard	1.0	<1			Repeat			MCL		
2/2/2016	18200 Buckboard	P	P			Routine					
1/4/2016	17720 Buckboard	A	A			Routine					
12/3/2015	18200 Buckboard	A	A			Routine					
11/10/2015	2720 Carriage	A	A			Routine	0.08				Cl2 from TC+ in October 2015
11/10/2015	17720 Buck Board	A	A			Routine	0.04				
11/10/2015	18000 Buck Board	A	A			Routine	0.09				
11/10/2015	18200 Buck Board	A	A			Routine	0.03				
11/10/2015	2633 Stagecoach	A	A			Routine	0.05				
10/9/2015	17840 Buckboard	A	A			Repeat					
10/9/2015	18000 Buckboard	A	A			Repeat					
10/9/2015	18020 Buckboard	A	A			Repeat				Yes	
10/7/2015	18000 Buckboard	P	A			Routine					
9/10/2015	2720 Carriage	A	A			Routine					
8/6/2015	2633 Stage Coach	A	A			Routine					
7/7/2015	18220 Buckboard	A	A			Routine					
6/10/2015	17720 Buckboard	A	A			Routine					
5/13/2015	18000 Buckboard	A	A			Routine					
4/1/2015	2720 Carriage	A	A			Routine					
3/4/2015	2633 Stagecoach	A	A			Routine					

Violation Key

MCL	Exceeds the maximum contaminant level	MR5	Incorrect number of repeat samples as follow-up to a positive sample
MR1	No monthly sample for the report month	MR6	No source sample
MR2	No quarterly sample for the report month	MR7	No summary report submitted
MR3	Incorrect number of routine samples for the report month	MR8	Other comments and/or info
MR4	Did not collect 5 routine samples for previous month's positive sample	MR9	Cl2 not reported

Source Bacteriological Monitoring Report

1500555 Mustang Mutual WS

<i>Sample Date</i>	<i>Time</i>	<i>Source</i>	<i>Sample Type</i>	<i>Test Method</i>	<i>T Coli</i>	<i>E Coli</i>	<i>F Coli</i>	<i>HPC</i>	<i>Violation</i>	<i>Comments</i>
3/2/2016		Well 01	Well	MPN	<1	<1				
2/3/2016	19:15	Well 01	GWR Well	MPN	<1	<1				
10/9/2015	8:27	Well 01	GWR Well	MPN	<1	<1				